

BVT-DPB 1

Probe-style attemperator



BVT-DPB1

ProbeProbe-style attemperator

About us

BVT Sweden was started with the ambition of becoming world leading in critical applications in process steam and thermal power plant turbine bypass. Based in Säftele, BVT Sweden employs experts with over 30 years experience in turbine bypass, steam conditioning, temperature control, design and manufacturing processes. We design turbine bypass valves, select actuation to fit our customer's requirements. Our products are optimized on a per-order basis, and we have the experience necessary to design special solutions. These products cover steam conditioning valves, pressure reduction valves, stop valves, desuperheaters and spray water control valves.


BVT-DPB1 steam attemperator

Attemperation is used for controlling the degree of superheat in a Heat Recovery Steam Generator (HRSG) or a boiler. Water is injected into the steam pipe using spring loaded atomizing nozzles. Attemperators are installed between the superheater stages in order to protect any secondary superheater pipes from damage owing to excessive heat, called "inter-stage". Another attemperator is often placed after the boiler / HRSG to regulate the output temperature of the boiler / HRSG or to ensure that the temperature upstream the turbine does not rise too quickly.

The BVT-DPB1 is installed into the steam pipe using a welded connection. One (or several) NS nozzles are installed at the end of the probe, placing the injection point in the middle of the steam flow.

Key features

- ✓ Nozzles resistant to flashing
- ✓ Water atomization pressure is maintained at nozzle at any flow condition
- ✓ Flanged connection for easy access during maintenance
- ✓ Reliable temperature control

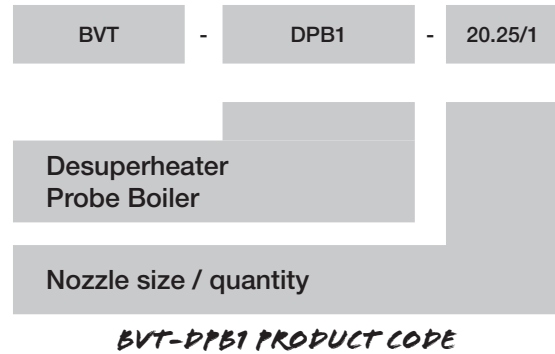

Specifications

Rangeability

Determined by spray water valve

Flange pressure class

EN PN 16-320

ASME 150-2500

Design temperature

Steam - 630 °C

Water - 250 °C

Materials


Nozzle body / plug X19Cr

Spring Heat resistant spring steel

Nozzles and springs are also available in Inconel for high temperature applications or conditions without water injection.

BVT-DPB1

ProbeProbe-style attenuator

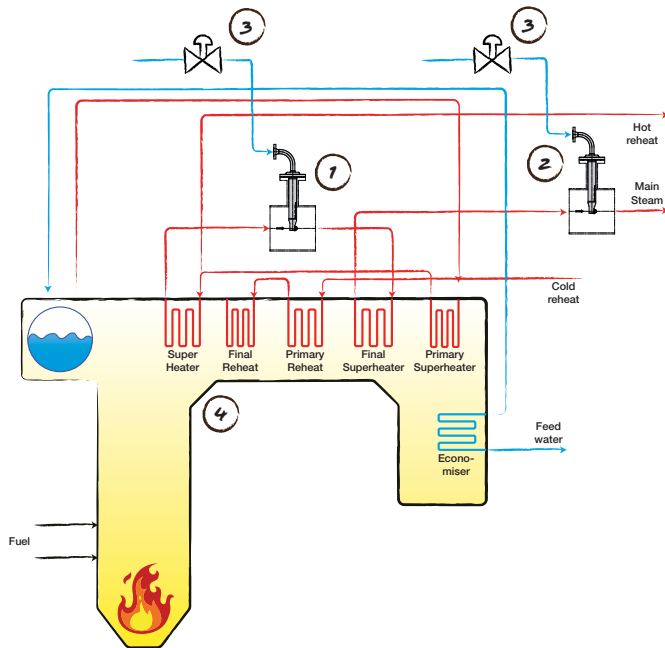

BVT-DPB1 IN BOILER ATTENUATOR APPLICATION

1. INTER-STAGE ATTENUATOR
2. FINAL STAGE ATTENUATOR
3. SPRAY WATER CONTROL VALVE
4. BOILER



NS SPRING-LOADED NOZZLE

BVT-DPB1

ProbeProbe-style attenuator



Water valves

BVT provides a multitude of spray water control valves, selected and designed to match operating conditions and customer requirements. The trims are chosen to prevent cavitation and flashing and prevent aerated liquids from corroding or eroding valve parts. They are equipped with quick exchange trims for more convenient inspection replacement. Among the options of trim designs are contour plugs, multi-step plugs, multi-cage and labyrinth disc stacks.

Trim types

PT (Plug throttling)
Cv Range: 1.4 ~ 9930
Rangeability: 25 to 1
Leakage class: IV / V

HSC (Micro High Step Cascade)
Cv Range: 0.24 ~ 406
Rangeability: 100 to 1
Leakage class: V

HES (Single seat, drilled cage)
Cv Range: 38 ~ 8900
Rangeability: Varies
Leakage class: IV / V



LEFT: ANGLE-STYLE VALVE BODY
RIGHT: GLOBE STYLE VALVE BODY

Lloyd's Register

Certificate of Approval

This is to certify that the Management System of:

BVT Sweden AB
Körkarlsvägen 8, 653 46 Karlstad, Sweden

has been approved by LRQA to the following standards:
ISO 14001:2015 | ISO 9001:2015

P.G. Cornelissen - Area Manager North Europe
Issued by: LRQA Sverige AB
for and on behalf of: Lloyd's Register Quality Assurance Limited

Current issue date: -
Expiry date: -
Certificate identity number: 10169985

Original approval(s):
ISO 14001 - 1 February 2019
ISO 9001 - 1 February 2019

Approval number(s): ISO 14001 - 00002108 / ISO 9001 - 00002109

The scope of this approval is applicable to:
Sales, development, engineering, service and upgrades of valves and accessories for power and process applications.

Lloyd's Register Group Limited, its affiliates and subsidiaries, including Lloyd's Register Quality Assurance Limited (LRQA), and their respective officers, employees or agents are, individually and collectively, referred to in this clause as the "Lloyd's Register". The Lloyd's Register assumes no responsibility and shall not be liable to any person for any loss, damage or expense caused by reliance on the information or advice in this document or otherwise provided, unless that person has agreed a contract with the relevant Lloyd's Register entity for the provision of the information or advice and is that person's responsibility or liability is exclusively on the terms and conditions set out in that contract. Head Office: Lloyd's Register Group Ltd, One The Quadrant, London EC4A 3DF, United Kingdom.

Lloyd's Register

Certificate No. / Zertifikat Nr.: 50329/1

CERTIFICATE

in accordance with the requirements of the Pressure Equipment Directive 2014/68/EU

ZERTIFIKAT
in Übereinstimmung mit den Anforderungen der Druckgeräterichtlinie 2014/68/EU

This is to certify that the quality assurance system of
Hiermit wird bescheinigt, dass das Qualitätssicherungssystem des Unternehmens

BVT Sweden AB
SE-653 46 Karlstad
Sweden / Schweden

has been assessed by LR Deutschland GmbH in accordance with the requirements of Annex III
durch die LR Deutschland GmbH entsprechend den Forderungen des Anhangs III

Module H

to the Pressure Equipment Directive 2014/68/EU and
conforms to the requirements for the products shown below:
der Druckgeräterichtlinie 2014/68/EU geprüft und bewertet wurde und für die folgenden Produkte die Anforderungen erfüllt:

Valves and accessories for power and process applications,
for details see Annex 1 to this certificate.
Ventile und Ausrüstungsteile für Anwendungen in der Wärme- und Verfahrenstechnik,
Einzelheiten siehe Anhang 1 dieses Zertifikates.

Approval is subject to continued maintenance of the quality assurance system
in accordance with the requirements of the above-mentioned directive.
Die Zulassung gilt unter der Voraussetzung, dass das Qualitätssicherungssystem fortlaufend aufrechterhalten wird und
die Forderungen oben genannter Richtlinie erfüllt.

Authorisation is hereby given to use the below-mentioned Notified Body Identification Number
of LR Deutschland GmbH in accordance with the requirements of the specified directive
in relation to the products as named above:
Hiermit wird die Genehmigung erteilt, folgende Kennnummer der LR Deutschland GmbH als Notifizierte Stelle
in Übereinstimmung mit der angegebenen Richtlinie in Bezug auf die oben genannten Produkte zu verwenden:

CE 0525

Certificate expiry date / Zertifikatsgültigkeit bis: **31.01.2022**

Hamburg, 01.11.2019
Place and Date
Name, Signature, Certifier
K. Wolf
Name, Unterschrift, Zertifizierer

Lloyd's Register Group Limited, its affiliates and subsidiaries and their respective officers, employees or agents are, individually and collectively, referred to in this clause as the "Lloyd's Register". The Lloyd's Register assumes no responsibility and shall not be liable to any person for any loss, damage or expense caused by reliance on the information or advice in this document or otherwise provided, unless that person has agreed a contract with the relevant Lloyd's Register entity for the provision of the information or advice and is that person's responsibility or liability is exclusively on the terms and conditions set out in that contract. Head Office: Lloyd's Register Group Ltd, One The Quadrant, London EC4A 3DF, United Kingdom.

ZE-1110 en Rev. 3, (08/19) Lloyd's Register Deutschland GmbH, Überseeallee 10, D-20457 Hamburg, Deutschland T: +49 349 700 10-100 F: +49 950 69 2625 Email: PressureSystems.Germany@lr.org Seite 1 von 1

This is a copy of an electronic document. In the event of any conflict or ambiguity between the copy and the electronic document which is retained and published by Lloyd's Register, the original electronic and certified version shall always prevail.

Körkarlsvägen 8
653 46 Karlstad
SWEDEN

E-mail
sales@bvtsweden.com

Åmålsvägen 13
661 32 Säffle
SWEDEN