

# BVT-BO

Steam conditioning valve

---



### About us


BVT Sweden was started with the ambition of becoming world leading in critical applications in process steam and thermal power plant turbine bypass. Based in Säftele, BVT Sweden employs experts with over 30 years experience in turbine bypass, steam conditioning, temperature control, design and manufacturing processes. We design turbine bypass valves, select actuation to fit our customer's requirements. Our products are optimized on a per-order basis, and we have the experience necessary to design special solutions. These products cover steam conditioning valves, pressure reduction valves, stop valves, desuperheaters and spray water control valves.

### The turbine bypass system

The turbine bypass system consists of both pressure reduction and steam desuperheating. Turbine bypass valves are installed in parallel with the turbine's pressure stages and provide a secondary conduit for the superheated steam. The valves may be used for controlling the downstream pressure and temperature during turbine operation or during a turbine trip.

### Bypass to condenser

The illustration on the right shows an example of a steam turbine with three pressure stages (HP, IP and LP) connected to a HRSG. The HP steam conditioning valve is connected in parallel with the high pressure stage of the turbine, and is fed water from a spray water control valve. A second steam conditioning valve is connected to a downstream dump tube, which dumps steam to the condenser. Condensate is pumped from the condenser and passed to the HRSG and to the spray water control valves.

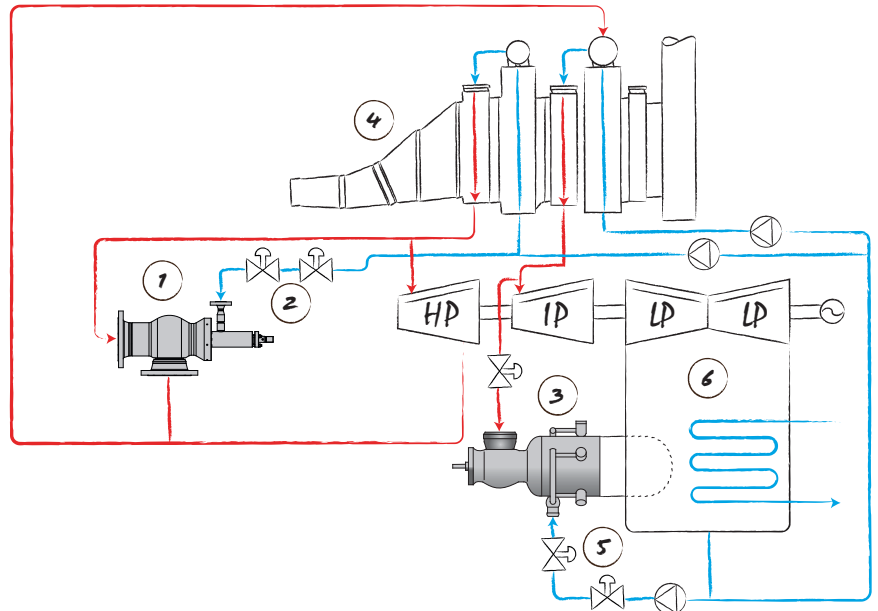

1. BVT-BO STEAM CONDITIONING VALVE
2. HP WATER CONTROL / STOP VALVE
3. BVT-TB STEAM CONDITIONING VALVE
4. HRSG
5. IP WATER CONTROL VALVE
6. WATER COOLED CONDENSER

**BVT-BO INSTALLED AS A HP TURBINE BYPASS VALVE**

# BVT-BO

Steam conditioning valve

## BVT-BO turbine bypass valve

The BVT-BO is an angle-style steam conditioning valve, used turbine bypass applications mainly in coal fired plants. It is designed to reduce temperature and pressure of steam to match downstream requirements. Pressure is controlled using a proven trim technology which reveals a series of perforations in the valve cage as the plug moves. The BVT-BO is designed so that the steam flow is pushing the plug towards its open position. Water is passed through a hollow stem and injected through small holes in the plug. The water mixes with the steam inside the cage before being passed through the cage into the outlet. The valve plug design is optimized for low actuating forces, allowing for smaller and pneumatic actuators.

## Specifications

Pressure class  
**Up to ANSI 4500 (higher rating on request)**

Design temperature  
**620 °C as standard (650 °C on request)**

Leakage class  
**ANSI Class III, IV, V, MSS SP 61**

Rangeability  
**Up to 25:1 for the complete valve**

Regulatory requirements  
**ASME, PED, IBR, CRN, ISO 9001/14001**


Materials  
**Forged material adapted to connecting pipe material**

Actuation  
**Pneumatic, hydraulic or electrical**

Options  
**- Expanded outlet**  
**- Live load gland seal packings**

## Key features

- ✓ Fully customizable inlet, outlet connections
- ✓ Complies with the following standards: ASME, EN, PED
- ✓ Forged valve body with uniform thickness and trim design optimized to withstand thermal cycling
- ✓ High shut-off class
- ✓ Excellent rangeability
- ✓ Balanced plug design requires smaller actuating forces, and so allows for smaller and pneumatic actuators
- ✓ Pressure seal bonnet for simpler and quicker maintenance. No special tools necessary
- ✓ Compatible with pneumatic, hydraulic and electrical actuation
- ✓ Easily exchangeable seat as option for further reduced maintenance downtime
- ✓ Optimized packing design

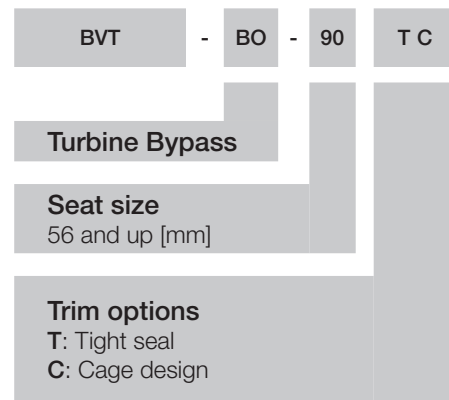

**BVT-BO PRODUCT CODE**

## Water valves

BVT provides a multitude of spray water control valves, selected and designed to match operating conditions and customer requirements. The trims are chosen to prevent cavitation and flashing and prevent aerated liquids from corroding or eroding valve parts. They are equipped with quick exchange trims for more convenient inspection replacement. Among the options of trim designs are contour plugs, multi-step plugs, multi-cage and labyrinth disc stacks.

## Trim types

PT (Plug throttling)  
**Cv Range: 1.4 ~ 9930**  
**Rangeability: 25 to 1**  
**Leakage class: IV / V**

HSC (Micro High Step Cascade)  
**Cv Range: 0.24 ~ 406**  
**Rangeability: 100 to 1**  
**Leakage class: V**

HES (Single seat, drilled cage)  
**Cv Range: 38 ~ 8900**  
**Rangeability: Varies**  
**Leakage class: IV / V**



**LEFT: ANGLE-STYLE VALVE BODY**  
**RIGHT: GLOBE STYLE VALVE BODY**

## Pneumatic actuation



BVT valves can be equipped with pneumatic piston actuators. The cylinders are chosen to overcome the forces created by steam flow, and the accessories are chosen to handle the required stroke speeds and functionality.

## Features and options

- Cylinder types
- Double Acting, Single Acting
  - Spring Open, Spring Close
  - Top mounted hand wheel, side mounted hand wheel

Air supply  
**4 - 10 bar**

- Accessories and options
- Air filter regulator as standard
  - 3-way valves (quick open/close)
  - Limit switches (open/close position)
  - Position transmitters, air locks, boosters as option

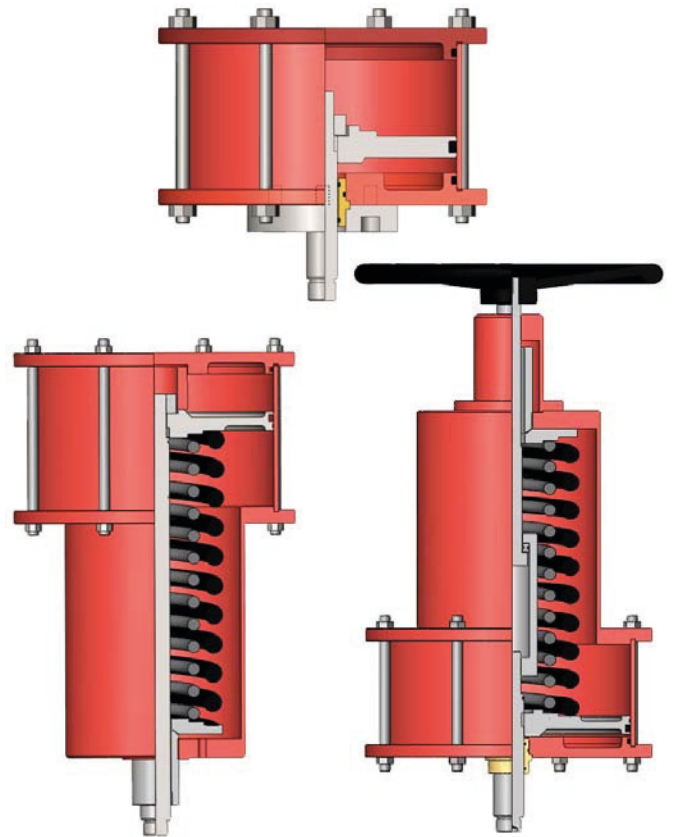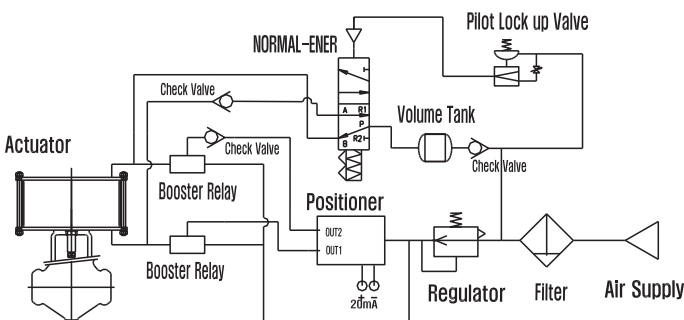

**TOP: DIFFERENT CYLINDER SOLUTIONS AVAILABLE**  
**LEFT: PNEUMATIC SCHEMATIC OF MODULATING ACTUATOR WITH AIR LOCK AND BOOSTERS**

# BVT-BO

Steam conditioning valve

## Hydraulics

As an alternative to pneumatic actuation, BVT can also provide our valves with electro-hydraulic actuators. To power and control these actuators, BVT also supply Hydraulic Control Panel (HCP) and Hydraulic Power Generator (HPG). Pump control in the HPG is by default handled by the Intelligent Power Manager (IPM). The IPM monitors oil level, temperature and pressures and warns the DCS of any issues. Positioning is by default is handled by the Intelligent Actuator Control (IAC), which can control two modulating and two on/off actuators.

Commissioning tools and hydraulic pipes, fittings and hoses are also available.

## Features

Hydraulic Linear Actuator

- C4 RAL7003 painting as standard, C5M as option
- Double rod seals & metal scrapers
- Precise movement and positioning
- No programming of transmitter required
- 2x Limit switches DPDT
- Spring and cylinder mounted valve block (HCB) as option

Hydraulic Control Panel

- Dual gain proportional valve for quick open/close
- Roof and floor stand as option
- Local accumulator as option
- Intelligent Actuator Control positioner as standard

Hydraulic Power Generator


- Intelligent Power Manager pump controller as standard
- Dual pumps, accumulators, spill tray
- Analog pressure, temperature and level transmitters as standard

Intelligent Actuator Control

- 2x modulating + 2x on/off control
- Smooth movement and accurate positioning
- One-click calibration of transmitters
- IP66, -20° to +55°C ambient temperature
- PC based service tool for setup
- S shaped ramps for smooth movement

Intelligent Power Manager

- HMI display as standard
- IP66, -20° to +55°C ambient temperature
- Automated pipe flushing function
- Local / remote control
- Redundancy as option
- Different bus protocols as option

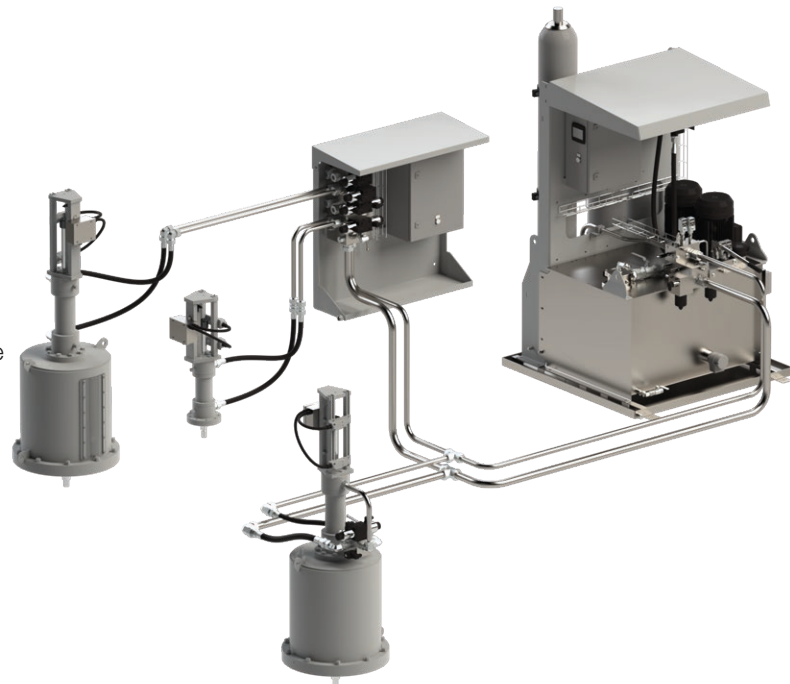

*HPG, HCP AND THREE HYDRAULIC CYLINDERS*

Certificates

 Certificate No. / Zertifikat Nr. 50329/1

**CERTIFICATE**  
in accordance with the requirements of the Pressure Equipment Directive 2014/68/EU

ZERTIFIKAT  
in Übereinstimmung mit den Anforderungen der Druckgeräterichtlinie 2014/68/EU

This is to certify that the quality assurance system of  
Hiermit wird bescheinigt, dass das Qualitätssicherungssystem des Unternehmens

**BVT Sweden AB**  
**SE-653 46 Karlstad**  
**Sweden / Schweden**

has been assessed by LR Deutschland GmbH in accordance with the requirements of Annex III  
durch die LR Deutschland GmbH entsprechend den Forderungen des Anhangs III

**Module H**

to the Pressure Equipment Directive 2014/68/EU and  
conforms to the requirements for the products shown below:  
der Druckgeräterichtlinie 2014/68/EU geprüft und bewertet wurde und für die folgenden Produkte die Anforderungen erfüllt:

**Valves and accessories for power and process applications,  
for details see Annex 1 to this certificate.**  
**Ventile und Ausrüstungsteile für Anwendungen in der Wärme- und Verfahrenstechnik,  
Einzelheiten siehe Anhang 1 dieses Zertifikates.**

Approval is subject to continued maintenance of the quality assurance system  
in accordance with the requirements of the above-mentioned directive.  
Die Zulassung gilt unter der Voraussetzung, dass das Qualitätssicherungssystem fortlaufend aufrechterhalten wird und  
die Forderungen oben genannter Richtlinie erfüllt.

Authorisation is hereby given to use the below-mentioned Notified Body Identification Number  
of LR Deutschland GmbH in accordance with the requirements of the specified directive  
in relation to the products as named above:  
Hiermit wird die Genehmigung erteilt, folgende Kennnummer der LR Deutschland GmbH als Notifizierte Stelle  
in Übereinstimmung mit der angegebenen Richtlinie in Bezug auf die oben genannten Produkte zu verwenden:

**CE 0525**

Certificate expiry date / Zertifikatsgültigkeit bis: **31.01.2022**

  
**K. Wolf**  
Name, Signature, Certifier  
Name, Unterschrift, Zertifizierer


**Hamburg, 01.11.2019**  
Place and Date  
Ort und Datum

Lloyd's Register Group Limited, its affiliates and subsidiaries and their respective officers, employees or agents are, individually and collectively, referred to in this clause as the "Lloyd's Register". The Lloyd's Register assumes no responsibility and shall not be liable to any person for any loss, damage or expense caused by reliance on the information or advice in this document or howsoever provided, unless that person has signed a contract with the relevant Lloyd's Register entity for the provision of this information or advice and in that case any responsibility or liability is exclusively on the terms and conditions set out in that contract.

ZE-1110 en Rev. 3, (08/19) Lloyd's Register Deutschland GmbH, Überseeallee 10, D-20457 Hamburg, Deutschland Seite 1 von 1  
T: +49 349 700 10-100 F: +49 350 49 2625 Email: PressureSystems.Germany@lr.org


This is a copy of an electronic document. In the event of any conflict or ambiguity between the copy and the electronic document, which is retained and published by Lloyd's Register, the original electronic and certified version shall always prevail.

**MODULE H**

 **Certificate of Approval**


This is to certify that the Management System of:  
**BVT Sweden AB**  
Körkarlsvägen 8, 653 46 Karlstad, Sweden

has been approved by LRQA to the following standards:  
ISO 14001:2015 | ISO 9001:2015

  
P.G. Cornelissen - Area Manager North Europe  
Issued by: LRQA Sverige AB  
for and on behalf of: Lloyd's Register Quality Assurance Limited

Current issue date: - Original approval(s):  
Expiry date: - ISO 14001 - 1 February 2019  
Certificate identity number: 10169985 ISO 9001 - 1 February 2019  
Approval number(s): ISO 14001 - 00002108 / ISO 9001 - 00002109

The scope of this approval is applicable to:  
**Sales, development, engineering, service and upgrades of valves and accessories for power and process applications.**



Lloyd's Register Group Limited, its affiliates and subsidiaries, including Lloyd's Register Quality Assurance Limited (LRQA), and their respective officers, employees or agents are, individually and collectively, referred to in this clause as "Lloyd's Register". Lloyd's Register assumes no responsibility and shall not be liable to any person for any loss, damage or expense caused by reliance on the information or advice in this document or howsoever provided, unless that person has signed a contract with the relevant Lloyd's Register entity for the provision of this information or advice and in that case any responsibility or liability is exclusively on the terms and conditions set out in that contract.

Lloyd's Register Group Limited, its affiliates and subsidiaries, including Lloyd's Register Quality Assurance Limited (LRQA), and their respective officers, employees or agents are, individually and collectively, referred to in this clause as "Lloyd's Register". Lloyd's Register assumes no responsibility and shall not be liable to any person for any loss, damage or expense caused by reliance on the information or advice in this document or howsoever provided, unless that person has signed a contract with the relevant Lloyd's Register entity for the provision of this information or advice and in that case any responsibility or liability is exclusively on the terms and conditions set out in that contract.

**ISO 14001 AND ISO 9001**